


VICTORIA ELECTRIC COOPERATIVE

MATERIAL FURNISHED BY MEMBER:

For questions, please call VEC at (361)-573-2428
or Email Engineering@victoriaelectric.coop

- 1 Meter base purchased at VEC office at cost.
- X 2" Rigid Conduit (320A Meter requires 3" rigid conduit)
- 1 2" Weatherhead
- 2 2" Two-hole straps
- 2 Lockrings
- 1 Roof Flange
- 1 5/8" x 8' Copper-Clad Ground Rod
- 1 Ground Rod Clamp - 5/8"
- 8' Ground Wire (#6 min.)
- 1 3" Diameter Connecting Nipple (straight or offset type)
- 1 Main disconnect (breaker or fuse type) Must be installed on either side or below meter base outside of the building.
- 1 Hub for disconnect box
- 25' + TRW insulated Copper wire (load will determine size)

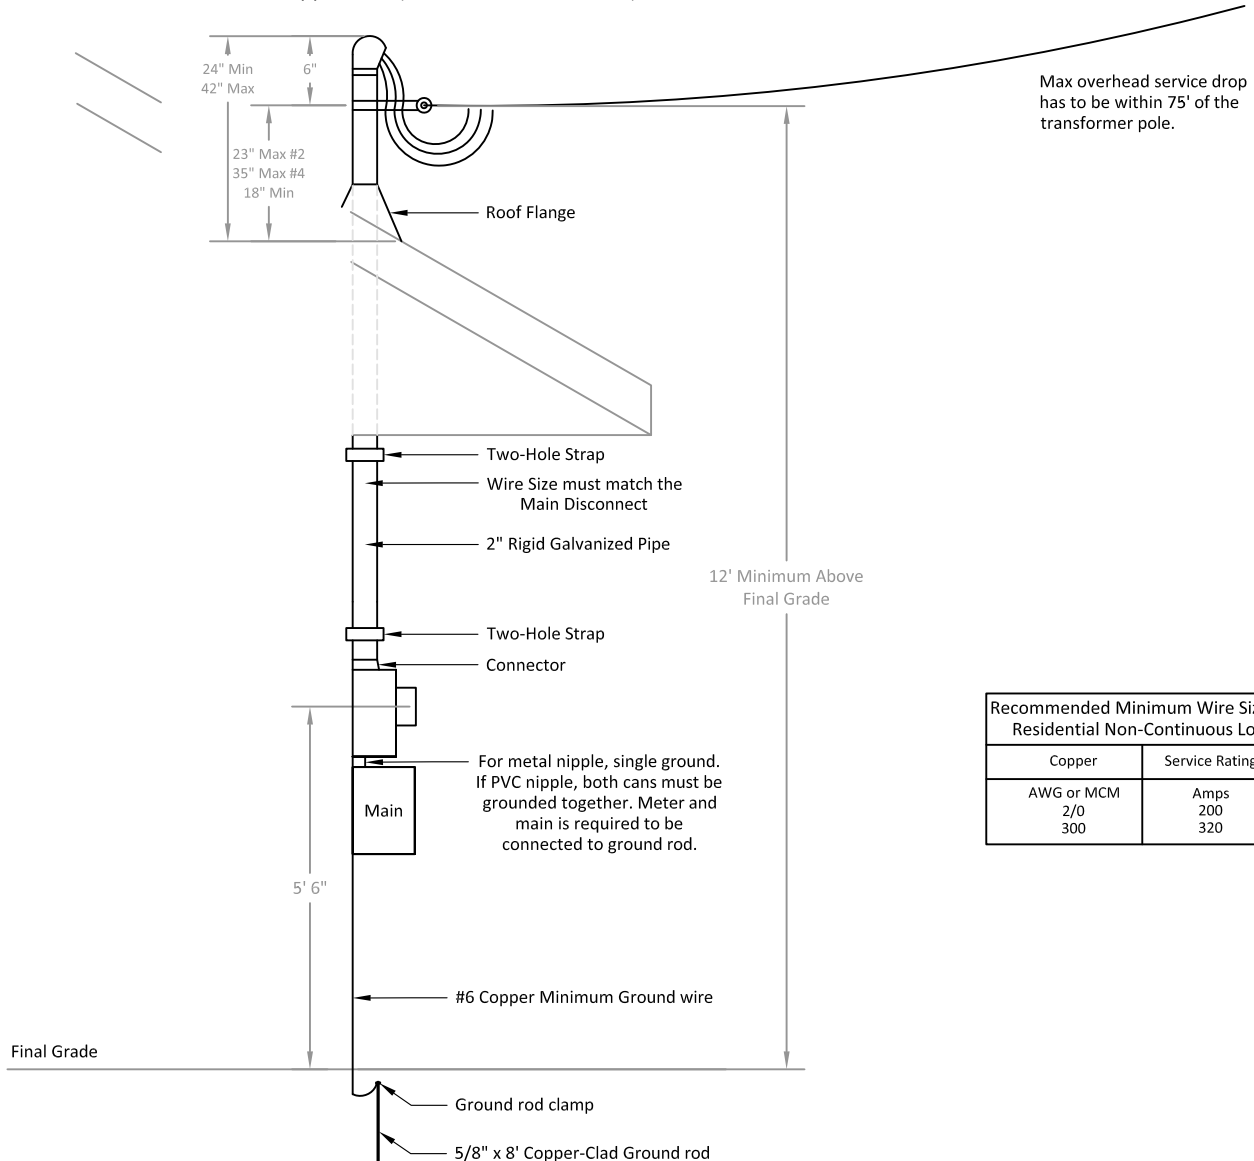

Recommended Minimum Wire Size for Residential Non-Continuous Load	
Copper	Service Rating
AWG or MCM	Amps
2/0	200
300	320

Sept 2023

Rev 2.02

Mast Type Meter Loop
Through Roof