


VICTORIA ELECTRIC COOPERATIVE

For questions, please call VEC at (361)-573-2428 or Email Engineering@victoriaelectric.coop

Notes:

- All PVC conduit above final grade shall be electrical grade schedule 80.
- All PVC conduit below grade shall be electrical grade schedule 40.
- Minimum 2" rigid pipe connecting panels.

Recommended Minimum Wire Size for Residential Non-Continuous Load	
Copper	Service Rating
AWG or MCM	Amps
2/0	200
300	320

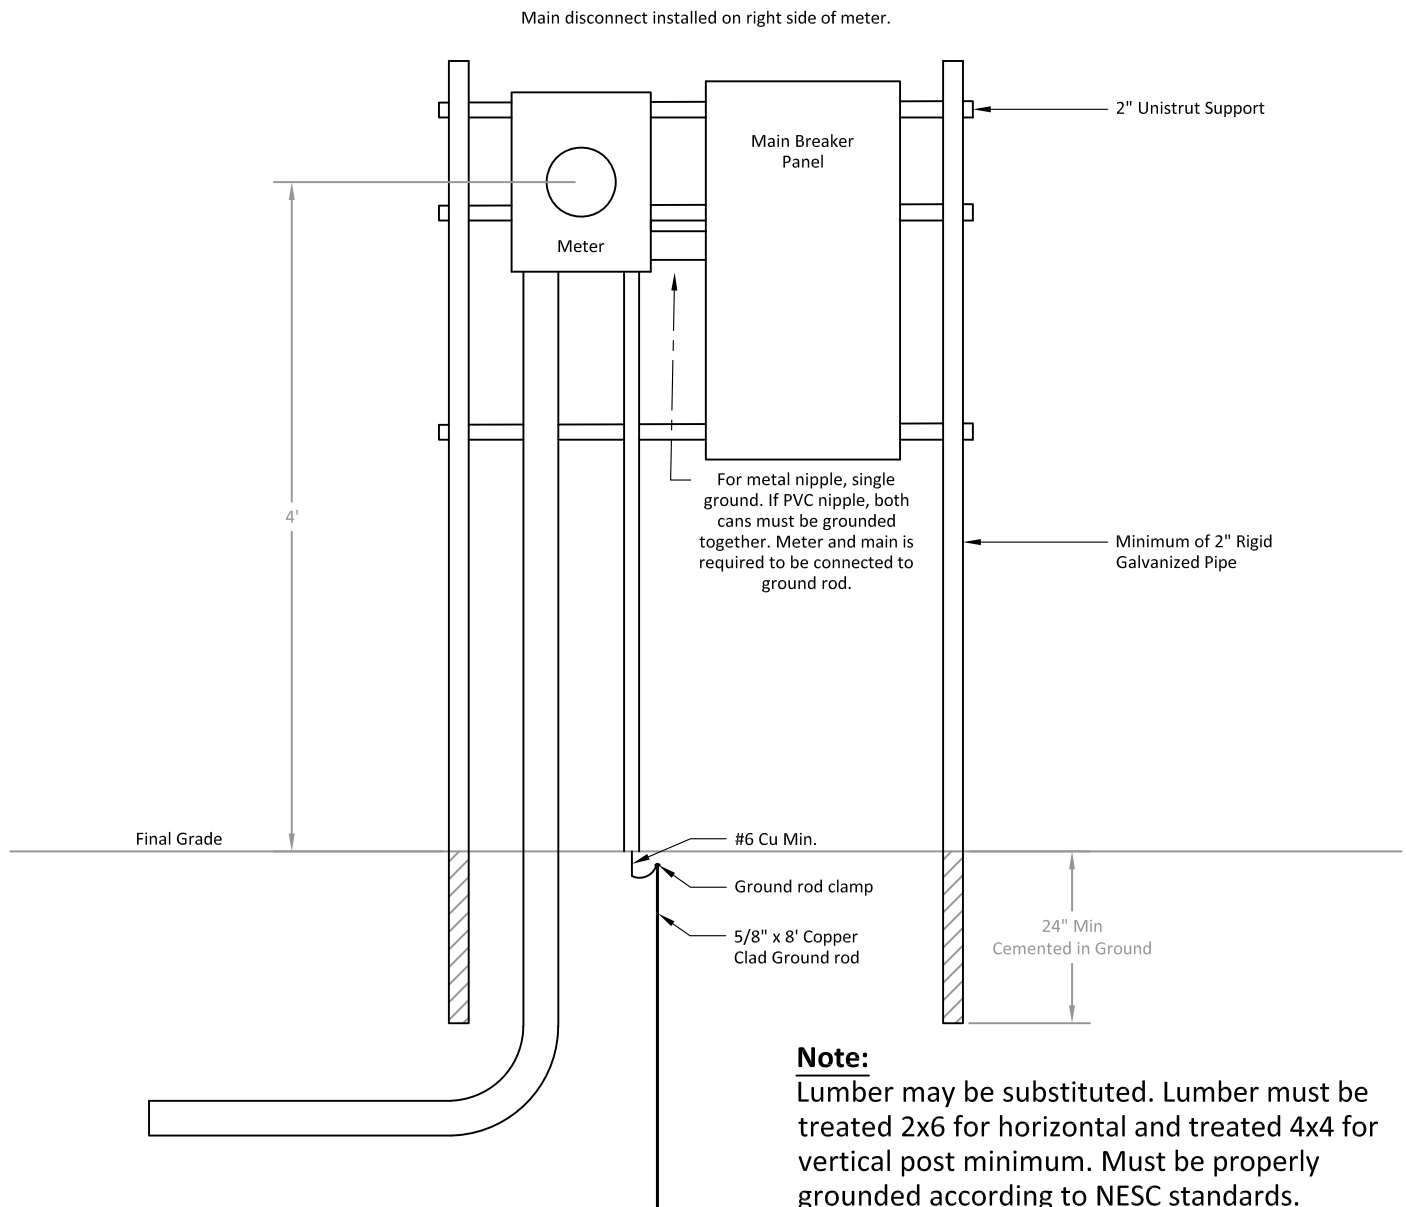

Sept 2023

Rev 2.01

Spec for Underground
Free-standing Meter