

VICTORIA ELECTRIC COOPERATIVE

For questions, please call VEC at (361)-573-2428 or Email Engineering@victoriaelectric.coop


This diagram is applicable for temporary service where member or electrician sets their own temporary meter pole. It is to be used only for construction or similar circumstances and not for permanent metering.

All material is to be supplied by the member.

Prior to connecting, all applications, inspections, easements and other pertinent information must have been approved and returned to our office.


Material Needed for 16' 4x4:

- 8' 2" Electric Metallic Tubing (EMT) or electrical PVC
- 1 Weatherhead
- 2-3 Two-Hole Straps
- 1 Connecting Nipple
- 1 Weathertight Connector
- 1 Weathertight Conduit Coupling
- 2 Lockrings
- 1 Main Disconnect
- 1 Hub for Disconnect Box
- 40' THHN insulated wire
- 2 2x4 Bracing (each 4' to 6')
- 1 5/8" x 8' Copper Clad Ground Rod
- 8' #6 Cu S.D. (Ground Wire)

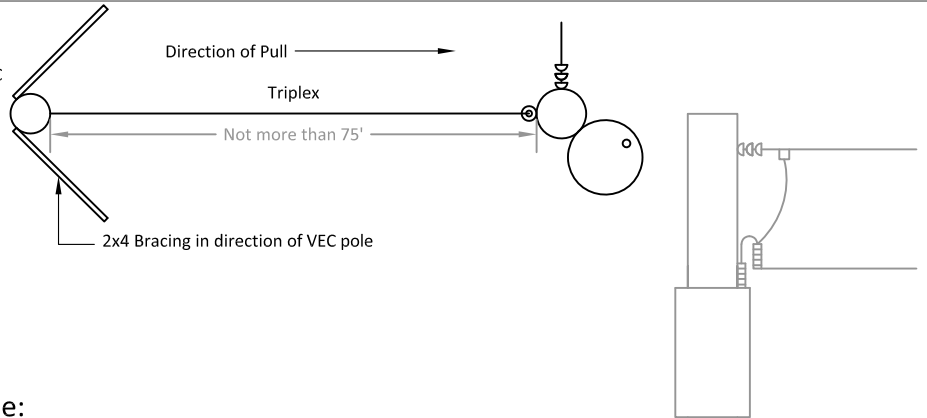

Material Needed for 20' Treated Pole:

- 10' 2" EMT or Electrical PVC
- 1 Weatherhead
- 2-3 Two-Hole Straps
- 1 Connecting Nipple
- 1 Weathertight Connector
- 1 Weathertight Conduit Coupling
- 2 Lockrings
- 1 Main Disconnect
- 1 Hub for Disconnect Box
- 50' THHN insulated wire
- 2 2x4 Bracing (each 4' to 6')
- 1 5/8" x 8' Copper Clad Ground Rod
- 8' #6 Cu S.D. (Ground Wire)

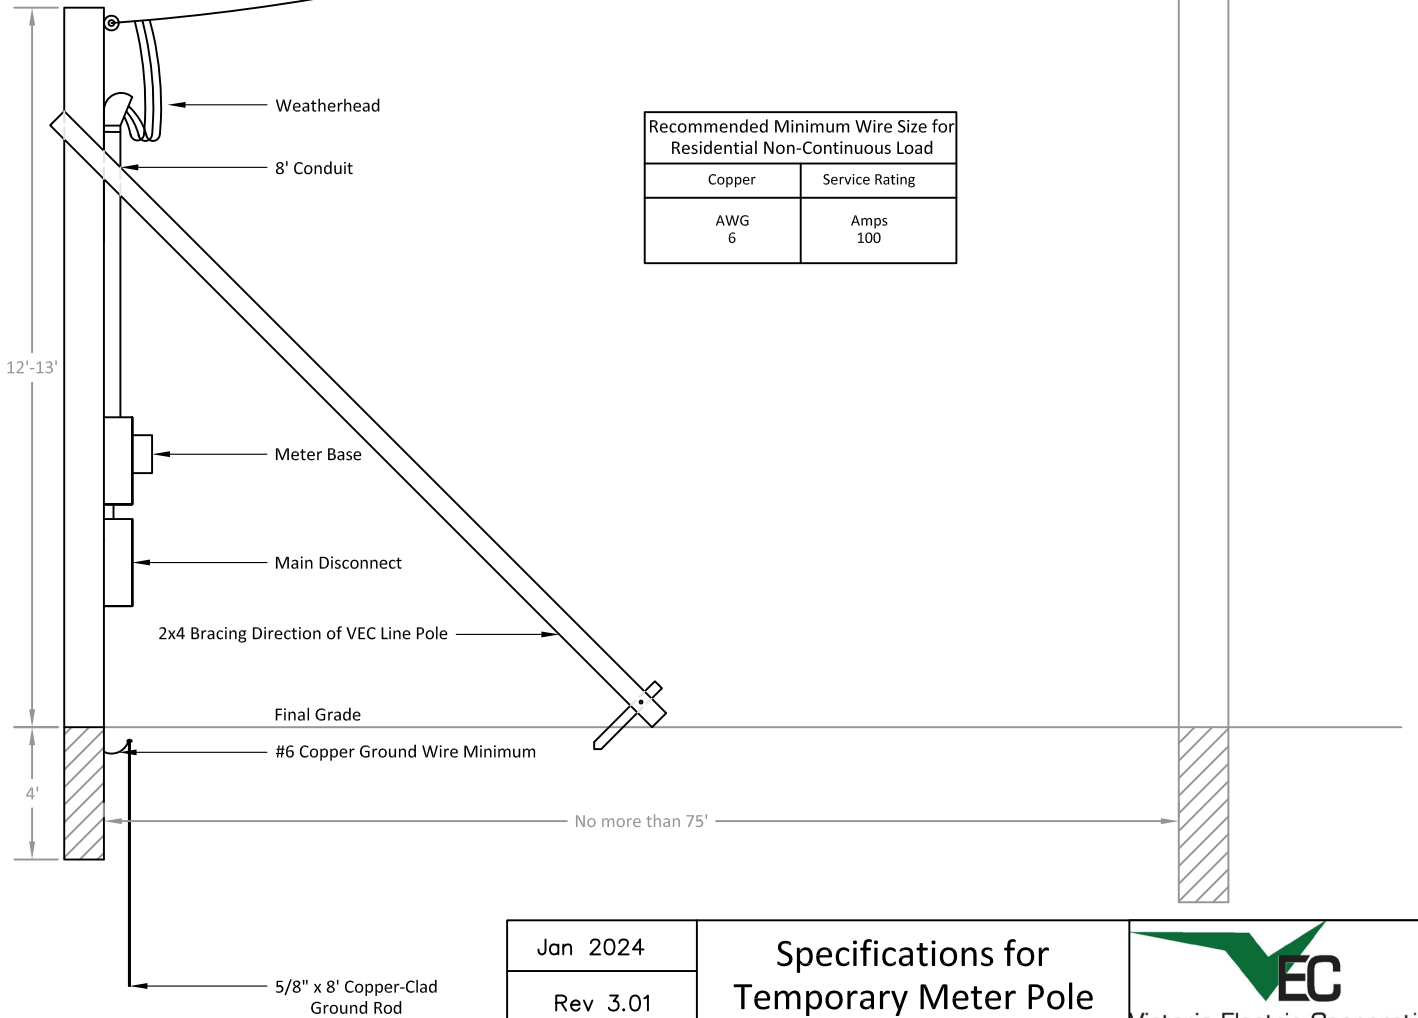

Jan 2024

Rev 3.01

Specifications for
Temporary Meter Pole