


VICTORIA ELECTRIC COOPERATIVE

MATERIAL FURNISHED BY MEMBER:

For questions, please call VEC at (361)-573-2428  
or Email [Engineering@victoriaelectric.coop](mailto:Engineering@victoriaelectric.coop)

- 1 Meter base (purchased at cost from VEC)
- X 2" Rigid Conduit for 200A meter service (320A meter service requires 3")
- 1 2" Weatherhead for 200A meter service (320A meter service requires 3")
- 2 2" Two-hole straps for 200A meter service (320A meter service requires 3")
- 2 Lockrings
- 1 Roof Flange
- 1 5/8" x 8' Copper-Clad Ground Rod
- 1 Ground Rod Clamp - 5/8"
- 8' Ground Wire (#6 min.)
- 1 3" Diameter Connecting Nipple (straight or offset type)
- 1 Main disconnect (breaker or fuse type) Must be installed on either side or below meter base outside of the building.
- 1 Hub for disconnect box
- 25' + THHN insulated Copper wire (load will determine size)

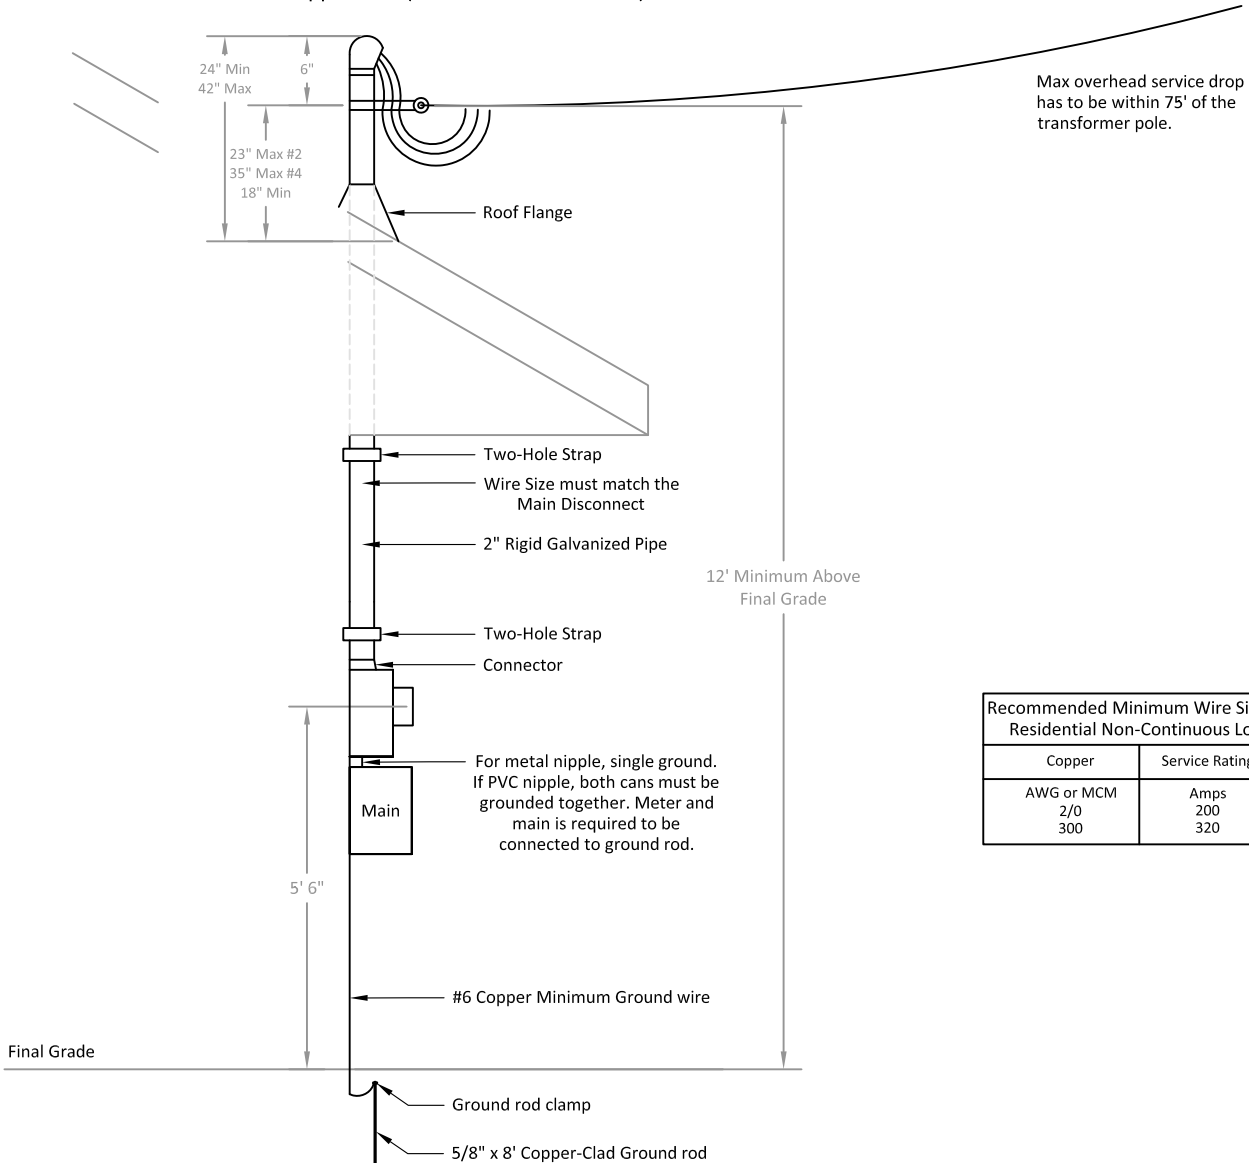

Recommended Minimum Wire Size for Residential Non-Continuous Load	
Copper	Service Rating
AWG or MCM	Amps
2/0	200
300	320